



SRK45ZSP-W1 / SRC45ZSP-W1

4.5(1.3~4.8)

Indoor Unit : SRK45ZSP-W1

Outdoor Unit : SRC45ZSP-W1


Specifications

R32

Indoor unit			SRK45ZSP-W1	
Outdoor unit			SRC45ZSP-W1	
Power source			1 Phase, 220 - 240V, 50Hz	
Nominal cooling capacity (Min~Max)			kW	4.5(1.3~4.8)
Nominal heating capacity (Min~Max)			kW	5.0(1.2~5.8)
Power consumption		Cooling/Heating	kW	1.390 / 1.360
EER/COP		Cooling/Heating		3.23 / 3.68
Max. running current			A	14.5
Sound power level	Indoor	Cooling/Heating	dB(A)	57 / 62
	Outdoor	Cooling/Heating		64 / 62
Sound pressure level	Indoor	Cooling (Hi/Me/Lo/Ulo)		44 / 37 / 22
		Heating (Hi/Me/Lo/Ulo)		48 / 40 / 28
	Outdoor	Cooling/Heating		51 / 51
Air flow	Indoor	Cooling (Hi/Me/Lo/Ulo)	m3/min	9.7 / 7.8 / 3.7
		Heating (Hi/Me/Lo/Ulo)		12.0 / 8.8 / 5.4
	Outdoor	Cooling/Heating		35.6 / 33.4
Exterior Dimensions	Indoor	Height x Width x Depth	mm	267 x 783 x 210
	Outdoor			595 x 780(+62) x 290
Net weight	Indoor / Outdoor		kg	7.0 / 24.0
Refrigerant	Type/GWP			R32 / 675
Refrigerant	Charge		kg/TCO2Eq	0.950 / 0.641
Refrigerant piping size	Liquid/Gas		ø inch	6.35(1/4") / 12.7(1/2"
Refrigerant line (one way) length			m	Max. 25
Vertical height differences		Outdoor is higher/lower	m	Max. 15 / Max. 15
Outdoor operating temperature range	Cooling		°C	-15~46
	Heating			-15~24
Clean filter				-
Energy Class (Cooling/Heating)				A+ +/A+
SEER				6.40
SCOP (Average climate)				4.20
Pdesign (cooling/heating(@-10°C))			kW	4.50/3.80
Annual Electricity Consumption (cooling/heating)			kWh/a	247/1266
Designated Heating Season				Average

- The data is measured under the following conditions(ISO-T1, H1). Cooling: Indoor temp. of 27°CDB, 19°CWB, and outdoor temp. of 35°CDB. Heating: Indoor temp. of 20°CDB, and outdoor temp. of 7°CDB, 6°CWB.
- Sound level indicates the value in an anechoic chamber. During operation these values are somewhat higher due to ambient conditions.
- 'tonne(s) of CO2 equivalent' means a quantity of greenhouse gases- expressed as the product of the weight of the greenhouse gases in metric tonnes and of their global warming potential.
- SEER/SCOP are based on EN14825:2016 and Commission regulation (EU) No.2016/2281

Schematics

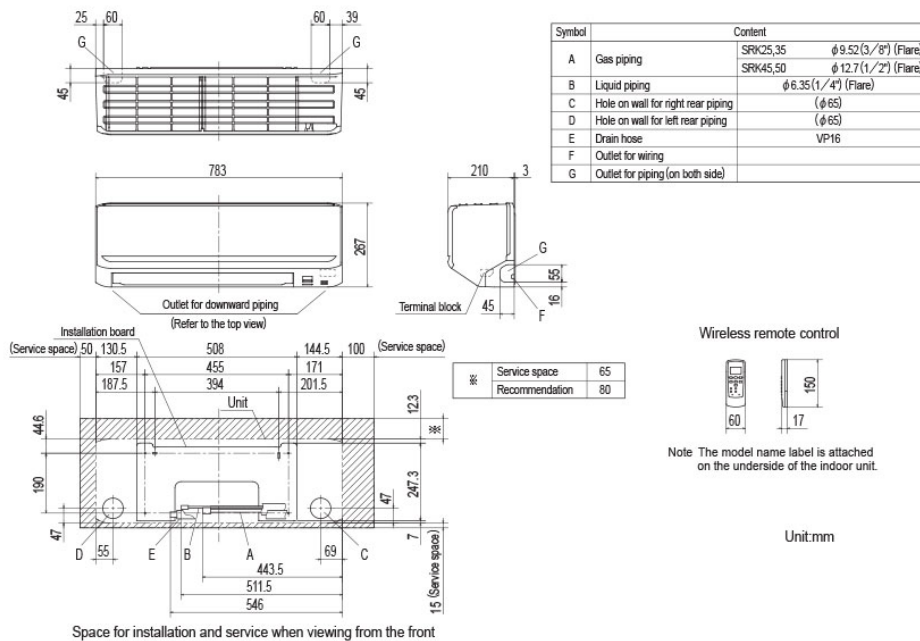




EXTERIOR DIMENSIONS

(1) Indoor units
Models SRK25ZSP-W1, 35ZSP-W1, 45ZSP-W1, 50ZSP-W1

Symbol	Content
A	Service valve connection (gas side) $\phi 12.7 (1/2")$ (Flare)
B	Service valve connection (liquid side) $\phi 6.35 (1/4")$ (Flare)
C	Pipe/cable draw-out hole
D	Drain discharge hole $\phi 20 \times 2$ places
E	Anchor bolt hole M10-12 $\times 4$ places

Notes

- (1) The unit must not be surrounded by walls on the four sides.
- (2) The unit must be fixed with anchor bolts.
An anchor bolt must not protrude more than 15mm.
- (3) If the unit is installed in the location where there is a possibility of strong winds, place the unit such that the direction of air from the outlet gets perpendicular to the wind direction.
- (4) Leave 200mm or more space above the unit.
- (5) The wall height on the outlet side should be 1200mm or less.
- (6) The model name label is attached on the right side of the unit.

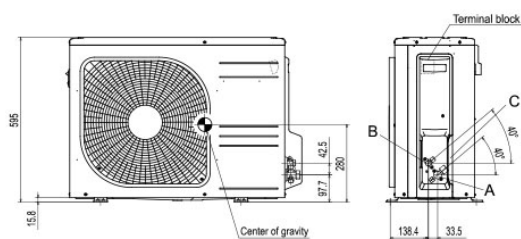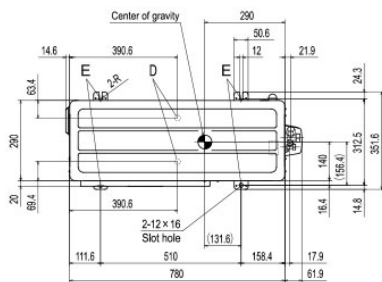

Installation space	
L1	280 or more
L2	100 or more
L3	80 or more
L4	250 or more

Unit:mm

Models SRC45ZSP-W1, 50ZSP-W1